

कार्यपालक अभियंता का कार्यालय
ग्रामीण कार्य विभाग, कार्य प्रमण्डल, उदाकिशुनगंज
पत्रांक.....316/अ००८.....उदाकिशुनगंज, दिनांक.....21.03.2023.....2023

प्रेषक,

कार्यपालक अभियंता,
ग्रामीण कार्य विभाग,
कार्य प्रमण्डल-उदाकिशुनगंज ।

सेवा में,

अपर मुख्य कार्यपालक पदाधिकारी -सह- सचिव,
ग्रामीण कार्य विभाग,
बिहार, पटना।

विषय :- MR New maintenance Policy 2018 योजना से संबंधित कार्यों के भुगतान हेतु आवंटन उपलब्ध कराने के संबंध में।


महाशय,

उपर्युक्त विषयक संबंध में कहना है, कि ग्रामीण कार्य विभाग, कार्य प्रमण्डल उदाकिशुनगंज में MR New maintenance Policy 2018 योजना के अंतर्गत चल रहे कार्यों के भुगतान हेतु विहित प्रपत्र में अधियाचना पत्र तैयार कर समर्पित किया जाता है।

अतः अनुरोध है, कि आवंटन शीघ्र उपलब्ध कराने की कृपा की जाय, ताकि संवेदक को भुगतान किया जा सके।

अनु०:- यथोक्त विहित प्रपत्र में।

विश्वासभाजन


कार्यपालक अभियंता,
ग्रामीण कार्य विभाग,
कार्यप्रमण्डल उदाकिशुनगंज।

21.03.23

FORM GER 19-ALetter No- **316** Date- **21.03.23**

(See Government of India's Decision (1) below Rule-150)

Form of Utilisation Certificate up to Feb 2023

New MR 2018

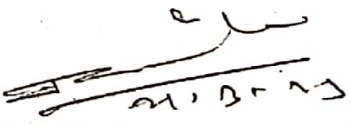

Executive Engineer Rural Works Department Works Division Udakishunganj

Sl No	Name of Scheme	Sanction No.& Date with Amount (in Rs. Lacs)	Amount Received (in Rs. lac)	particulars
1	New MR 2018	Secretary-Cum-Empowered Officer BRRDA, Patna Letter No-32 WE Date- 03.03.2023	3860.23373	Certified that Rs:- 3860.23373 Lac received Till the date in favour of Executive Engineer, RWD Work Division Udakishunganj. A sum of Rs. 3442.64633 Lac has been utilized for the purpose of New MR 2018 Scheme as given in the margin for which it was sanctioned and that the balance of Rs.417.58740 Lacs remaining .
TOTAL			3860.23373	

2. Certified that I have satisfied myself that conditions on which the grants in -aid was sanctioned have been duly fulfilled/are being fulfilled and that I have exercised the following checks to see that the money was actually utilized for the purpose for which it was sanctioned.
kind of checks exercised:-

- (i) Works have been supervised by Executive Engineer
- (ii) periodical inspection has been conducted by Executive Engineer
- (iii) construction material have been tested.
- (iv) Measurements have been recorded in the MBs and test check conducted by the Assistant Engineer,
- (v) All other codal formalities have been observed.

3. Physical progress achieved: as per progress report.


D.A.ORural Works Department
Works Division Udakishunganj
Executive EngineerRural Works Department
Works Division Udakishunganj
21.03.23

Requisition Format for Scheme Head - MR (3054) Under Bihar Rural Road maintenance Policy 2018 (Initial Rectification and Surface Renewal)

Name of Division : Udakishunganj

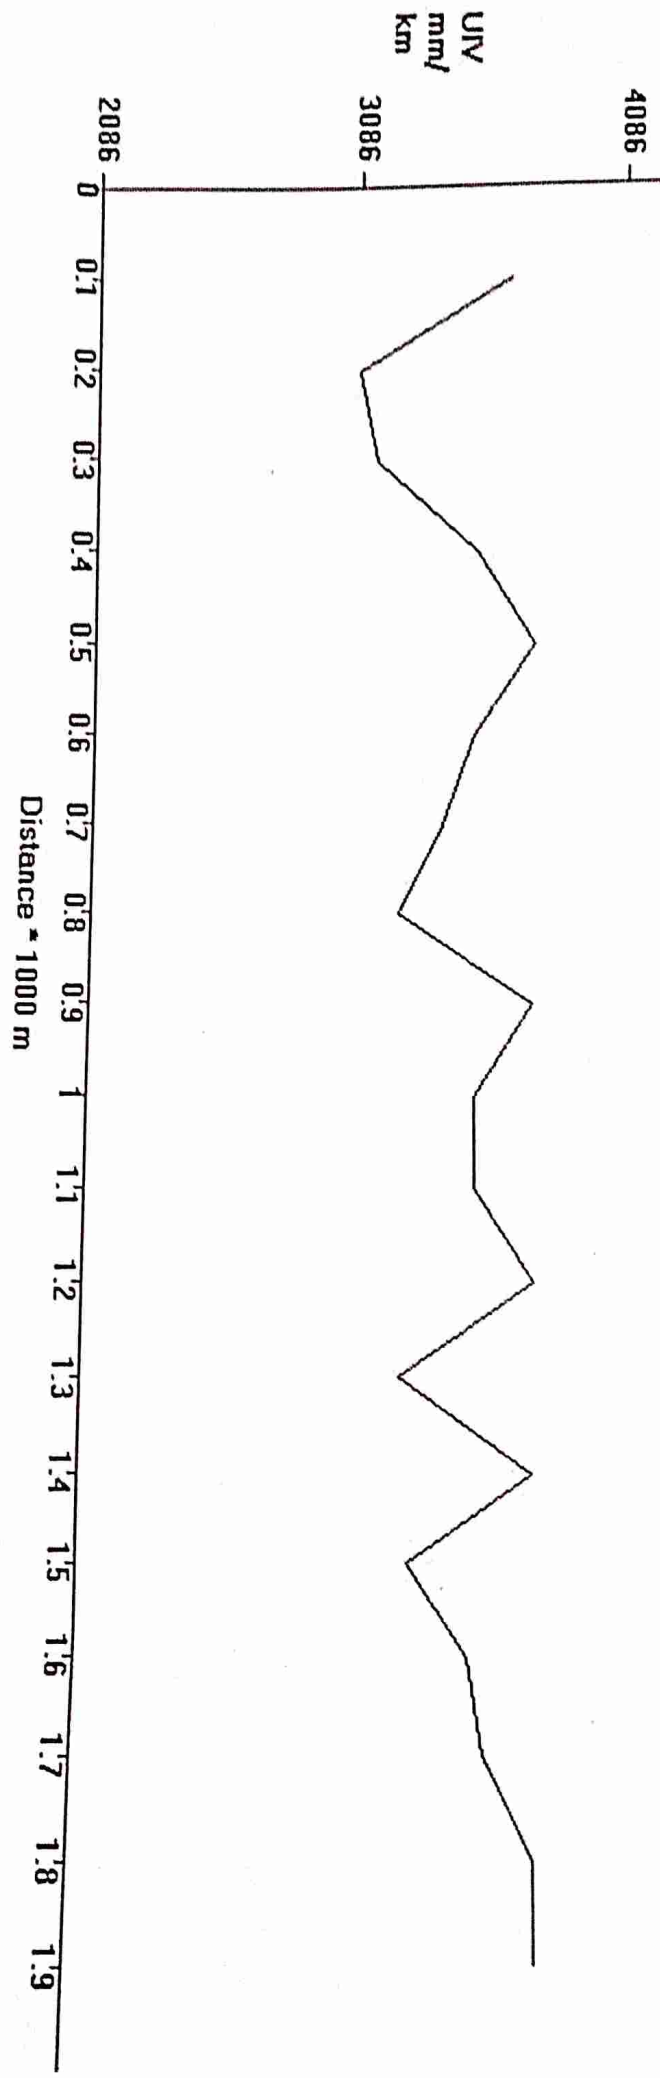
Sl.No	Package no.	Name of Road	Project ID as per MIS	Administrative Approval (AA) Letter No. & Date	Administrative Approval (AA)		Agreement Amount (in Lac)		Agreement No. & Date	Date of Completion as per Agreement	Actual Date of Completion	Value of IRI (in mm/km)	Thickness of Bitumen Layer (in mm)	Value of Bitumen Content in percentage	Previous Total Allotted Amount (I Lac)	up to date expenditure as per MIS (in Lac)	Requisition Against work done (in lac)
					Length (in Km)	Amount (in Lac)	Initial Rectification with Surface Renewal (in lac)	5 years Routine Maintenance (in lac)									
1	RM/MA/UDA/22/0001	LD41-T05 to Nohar (VR12)	21004802067	426/04/07.22	2.63	143.43	111.27659	29.63200	26MBD/2022-23/02.12.22	01-Sep-23	17/03.2023	3392.3	25mm	5%	0	0	111.26000
2	RM/MA/UDA/22/0001	LD41-Moti Chak to bhita Tola (VR232)	21004802065	426/04/07.22	1.89	110.127	81.83166	23.60925	26MBD/2022-23/02.12.22	01-Sep-23	16/03.2023	3529.2	25mm	5%	0	0	81.31000
3	RM/MA/UDA/22/0001	Terasi To Sahpur Durga Asthan Via Rengha	21004812041	426/04/07.22	1.83	96.21	67.94945	14.78755	26MBD/2022-23/02.12.22	01-Sep-23	18.03.2023	3508.0	25mm	5%	0	0	67.93000
Total																	261.00000

[Signature]
D.A.O
RWD Works Division
Udakishunganj

[Signature]
Executive Engineer
RWD Works Division
Udakishunganj

21/03/23

File : C:\Users\BRDDA64\OneDrive\Desktop\Aradhya\10112025.Xls, Section No. : 43, Eqn : $Y = 0 * X^2 + 1.136 * X - 0.0001$
 Name of Customer : M/s Aradhya Enterprises. Name of Work/ Road : Terasi To Sahpur Durga Asthan via Rengha.



Handwritten signature
 21/03/23
 JE

Handwritten signature
 21/03/2023
Handwritten signature

Handwritten signature
 21/03/23

Name of Road:- Terasi TO Sahpur Durga Asthan via Rengha

Contractor's Name:-M/s Aradhya Enterprises

Date	Time	Section No.	Length in km	Bumps in mm	Speed Rate	OR mm/km	UIV	CATEGORY ROAD	IRI	Latitude	Longitude	Event
18/03/23	9:55:0	43	0.1	310	0	3100	3654	G	4.8	25.78053	86.89864	Normal
18/03/23	9:55:18	43	0.1	320	20.2	2600	3086	G	4.13	25.77983	86.89943	Normal
18/03/23	9:55:18	43	0.1	290	30.3	2700	3154	G	4.8	25.77913	86.90029	Culvert
18/03/23	9:55:42	43	0.1	300	30.3	3000	3540	G	4.66	25.77838	86.90085	Normal
18/03/23	9:56:0	43	0.1	300	30.3	3200	3767	G	4.93	25.77784	86.90116	Normal
18/03/23	9:56:32	43	0.1	300	30.3	3000	3540	G	4.66	25.77668	86.90136	Normal
18/03/23	9:56:32	43	0.1	280	20.2	2900	3426	G	4.53	25.77652	86.90188	Curve
18/03/23	9:57:8	43	0.1	270	20.2	2800	3257	G	4.8	25.77569	86.90323	Normal
18/03/23	9:57:37	43	0.1	330	30.3	3200	3767	G	4.93	25.77534	86.90327	Normal
18/03/23	9:57:37	43	0.1	310	30.3	3000	3540	G	4.66	25.77475	86.9033	Normal
18/03/23	9:58:0	43	0.1	310	40.4	3000	3540	G	4.66	25.77408	86.90338	Normal
18/03/23	9:58:22	43	0.1	260	20.2	3200	3767	G	4.93	25.77276	86.90331	Culvert
18/03/23	9:58:22	43	0.1	310	30.3	3000	3269	G	5.19	25.77163	86.90325	Normal
18/03/23	9:59:4	43	0.1	310	30.3	3000	3540	G	4.66	25.77083	86.90317	Culvert
18/03/23	9:59:36	43	0.1	290	30.3	2700	3154	G	4.8	25.77019	86.90348	Curve
18/03/23	9:59:36	43	0.1	300	40.4	3000	3540	G	4.66	25.76955	86.90438	Curve
18/03/23	10:00:0	43	0.1	340	40.4	2900	3594	G	5.19	25.76885	86.90401	Normal
18/03/23	10:00:42	43	0.1	320	40.4	3200	3767	G	4.93	25.76794	86.90363	Normal
18/03/23	10:00:42	43	0.1	320	30.2	3200	3767	G	4.93	25.76695	86.90419	Curve
Average IRI									3508			

$$Y = 0 * X^2 + 1.136 * X + 132.5$$

$$X = 3200$$

$$Y = 3767$$

(R) RURAL ROAD
Average Poor
4001-5000 >5001

21/03/23
DB

21/03/23
DB

21/03/23
DB